

AB Tip İnceleme Sertifikası EU Type-Examination Certificate

Belge No / Certificate No : 65-20-02
**Belgelendirme Tarihi - Bir Sonraki Belge Tarihi /
Certification Date / Certificate Validity Date** : 10.11.2020-10.11.2025
Belge Geçerlilik Tarihi / Document Validity Period : 5 yıl / 5 years
**Firma Unvanı ve Adresi /
Company Name and Address** : LindenCare GmbH
Pempelforter Str. 50, 40211 Düsseldorf
Germany

Ürün Adı /Modeller / Product Name / Models : Lindenpartner LP1
Direktifi / Directive : 2016/425 REGULATION
Modülü/Kategori / Module / Category : B MODÜLÜ/ KATEGORİ III
MODULE B / CATEGORY III
Test Rapor No/ları / Test Report No : MNA M-2020-00435

Ürün Tipi / Product Type:

- EN 149+ A1 Solunumla ilgili koruyucu cihazlar - Parçacıklara karşı koruma amaçlı filtreli yarım maskeler/ Respiratory protective devices - Filtering half masks to protect against particles

Ürünün Malzeme Bilgisi / Product Material Information: Lindenpartner LP1 model ürünleri kumaş, kulak kayışı, burun klipsi ve filtre katmanı kullanılarak imal edilmiştir./ Lindenpartner LP1 model products are manufactured using fabric, ear strap, nose clip, filter layer.

Volkan AKIN
10.11.2020
Karar Verici / Approver



Okan AKEL
10.11.2020
Şirket Müdürü / General manager









ATTACHMENTS (65-20-02)

To certify the PPE product at Category III level, C2 or D module is accompanied by applying one of the conformity assessment methods along with the EU Type Examination (Module B).

Model : Lindenpartner LPI

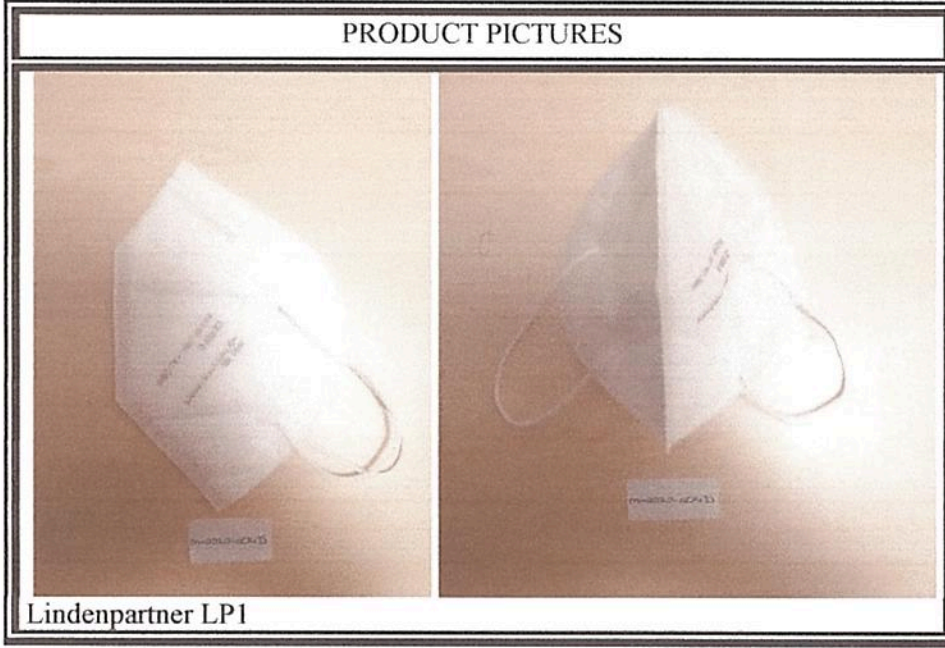
PPE SPECIFICATION	PERFORMANCE LEVELS
Classification	FFP2
Reusable / Single Shift Use	NR

PPE produced as a single unit to fit an individual user, all the necessary instructions for manufacturing such PPE on the basis of the approved basic model:

MARKING	
MANUFACTURER: LindenCare GmbH	
PPE TYPE :	
- EN 149+ A1 Respiratory protective devices - Filtering half masks to protect against particles	
MODEL: Lindenpartner LPI	
PICTOGRAM AND PERFORMANCE LEVELS:	
EN 149+ A1 FFP2 NR	
 NB 2841	
 Year Month	 yyyy/mm
 -xx°C +yy°C	 < xx%
Or Condition of Storage	

MNA LABORATORIES SAN. TIC. LTD. ŞTİ declares that the above-mentioned product meets the requirements of the directive according to the EU Directive 2016/425, the safety of the product is covered by the conditions and use specified in this certificate and in the technical file.

ATTACHMENTS (65-20-02)



DOCUMENTS IN THE TECHNICAL

- Basic Health Safety Requirements
- Risk Assessment
- Test Reports
- Technical Report